

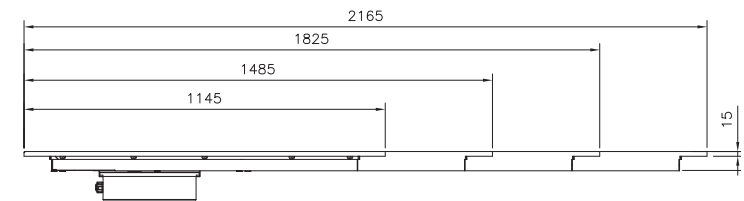
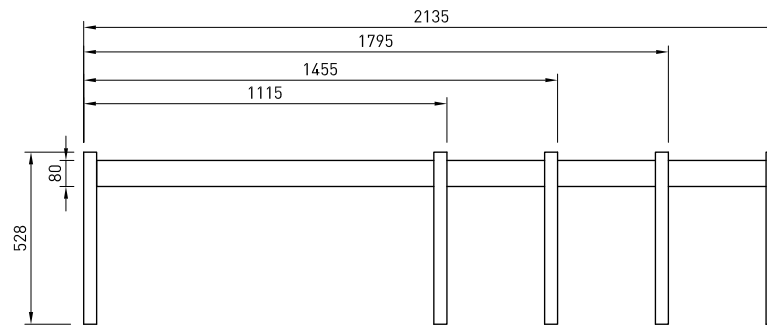


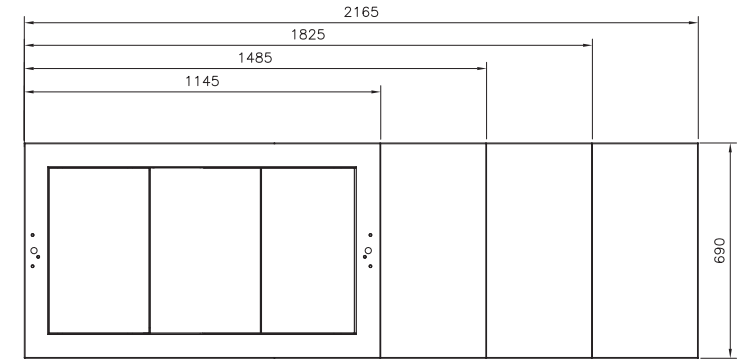

## CM

LSCM3  
LSCM4  
LSCM5  
LSCM6

- Ceramic Heated Glass
- Overhead Halogen Lamps
- Digital thermostatic controller
- Heat indicating LED lights

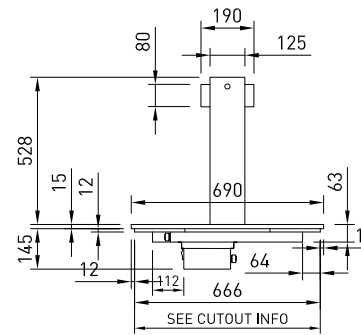


## CABINET DIMENSIONS & SPECIFICATIONS

MODEL	CABINET			WEIGHT KG	BENCH TOP CUT OUT HOLE SIZE	TEMP RANGE DEG C	DISPLAY AREA M2	FREQUENCY	OPERATING CURRENT WITH LAMPS	OPERATING CURRENT NO GANTRY	POWER WITH LAMPS KW 230V	CONNECTION ELECTRICAL POWER CORD 3000MM NZ/AUS/UK	VOLTAGE	PACKED FOR SHIPPING			
	LENGTH [MM]	DEPTH [MM]	HEIGHT [MM]											LENGTH [MM]	DEPTH [MM]	HEIGHT [MM]	WEIGHT [KG]
LSCM3	1145	690	555	65	1115x672	60 -70	0.51	50/60 HZ	11.7 AMP		2.691	15 AMP LEAD ONLY	220-240V	1250	770	410	88
LSCM4	1485	690	555	85	1455x672	60 -70	0.68	50/60 HZ	15.7 AMP		3.611	20 AMP LEAD ONLY	220-240V	1590	770	410	107
LSCM5	1825	690	555	97	1795x672	60 -70	0.86	50/60 HZ	19.6 AMP		4.508	20 AMP LEAD ONLY	220-240V	1930	770	410	128
LSCM6	2165	690	555	109	2135x672	60 -70	1.04	50/60 HZ	23.5 AMP		5.405	30 AMP LEAD ONLY	220-240V	2270	770	410	140
LSSC1	570	365	1.5	18	545 x 338	60 -70		50/60 HZ	2.52 AMP		0.579	10 AMP 3 PIN PLUG	220-240V	680	420	165	20



## CM<sup>LSSC1</sup>





- Single ceramic heated glass
- Digital thermostatic controller
- Heat indicating LED lights on panel
- Flush mount drop in module

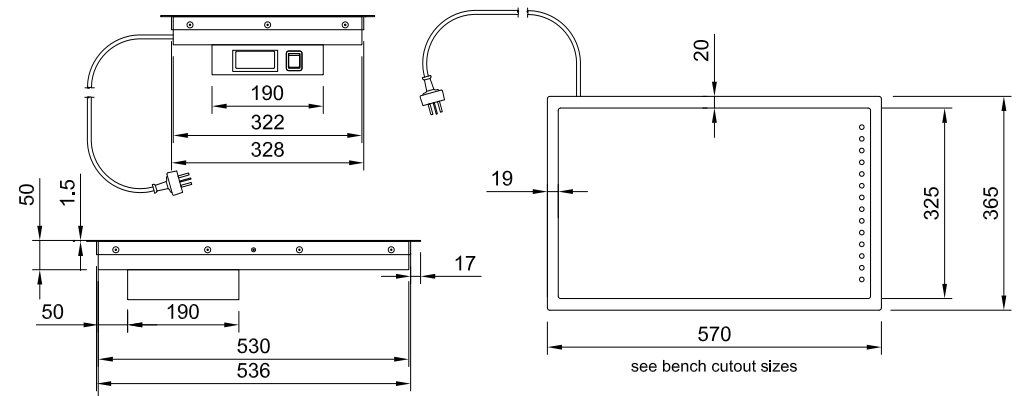

## ELECTRICAL POWER

Electrical power cord 3000mm  
1 phase connection required.


Unit can be hard wired to isolation switch or fitted with suitable heavy duty plug such as PDL 56 series or Commando style plug.

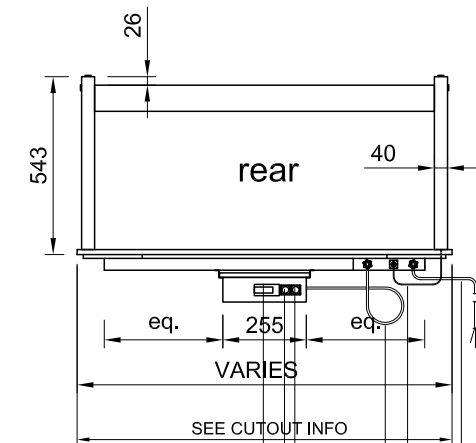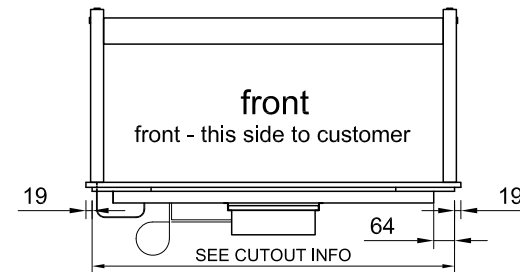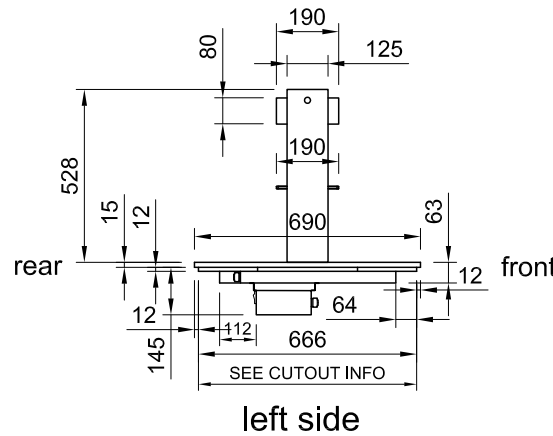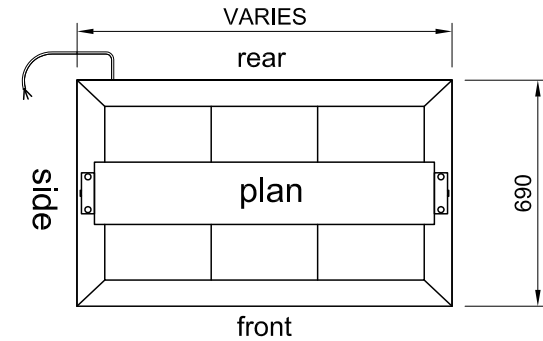

Panel  
Controllers  
LSCM 2/3 X1  
LSCM 4/5/6 X 2

## PANEL CONTROLLERS

MODEL	NUMBER OF PANELS	NUMBER OF CONTROLLERS	GROUP OF PANELS CONTROLLED
LSCM3	3	1	CONTROLLER 1 - 3
LSCM4	4	2	CONTROLLER 1 - 2 CONTROLLER 2 - 2
LSCM5	5	2	CONTROLLER 1 - 2 CONTROLLER 2 - 3
LSCM6	6	2	CONTROLLER 1 - 3 CONTROLLER 2 - 3


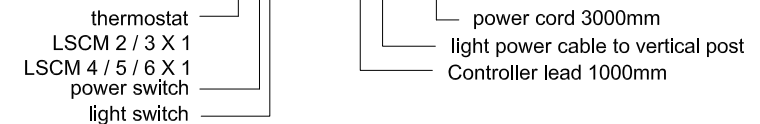


## GLASS CANOPY OPTIONS



ASSEMBLY REQUIRED




GLFT Flat Top

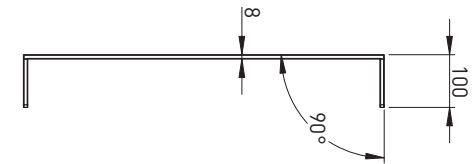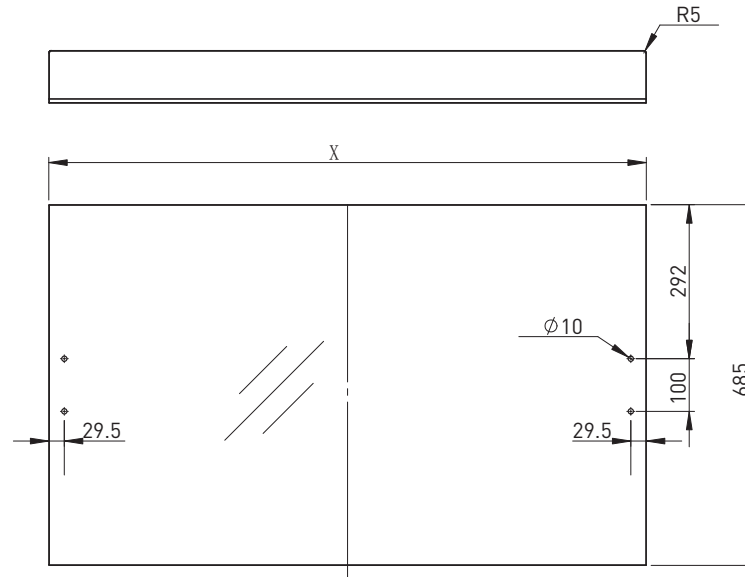


GLFS Full Square Glass

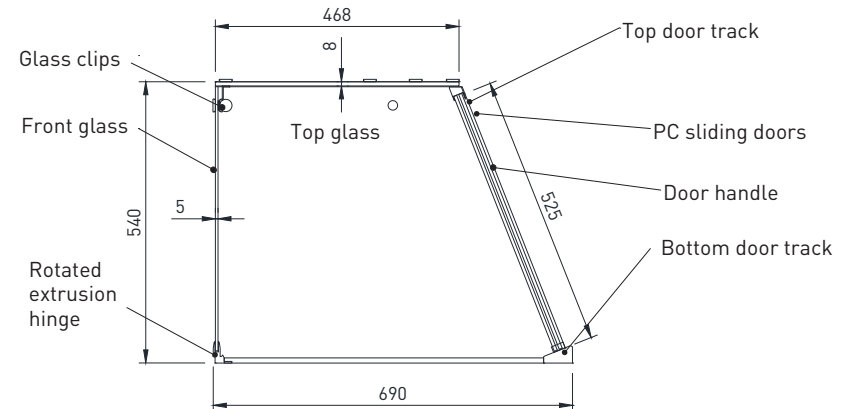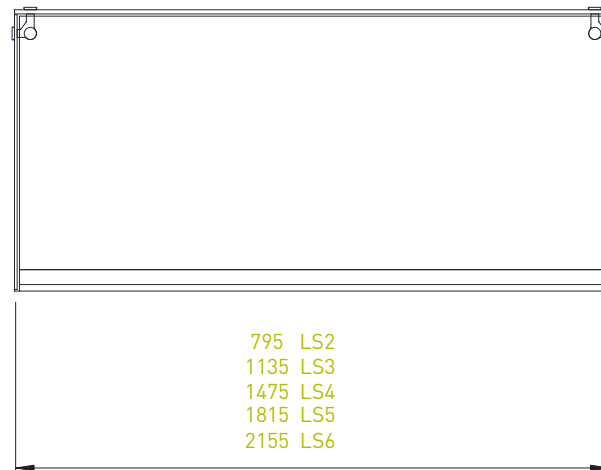


## FLUSH BENCH TOP DETAIL

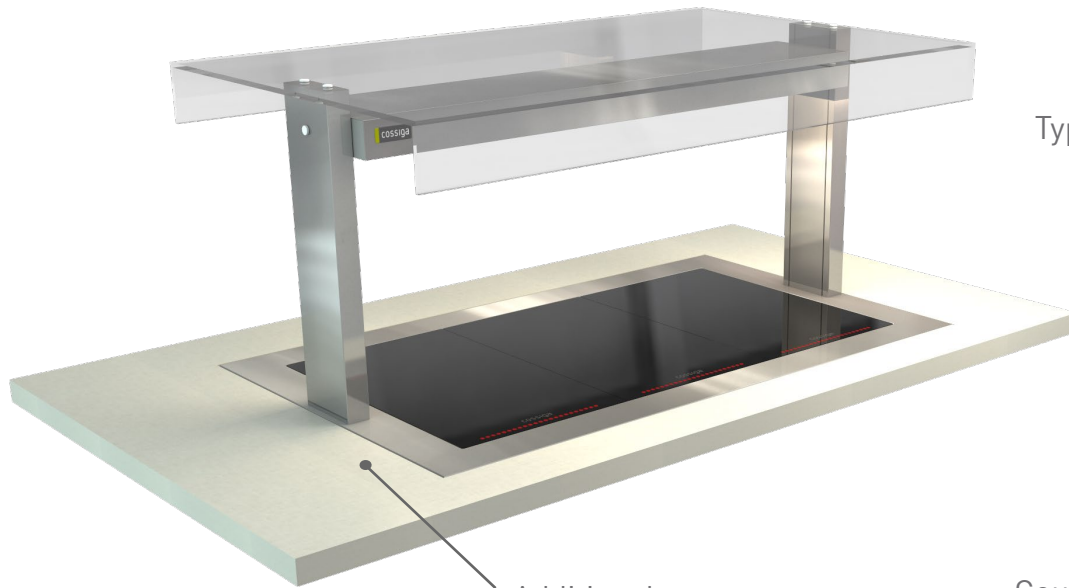


Additional support may be required under bench ie. stainless steel hollow section to frame

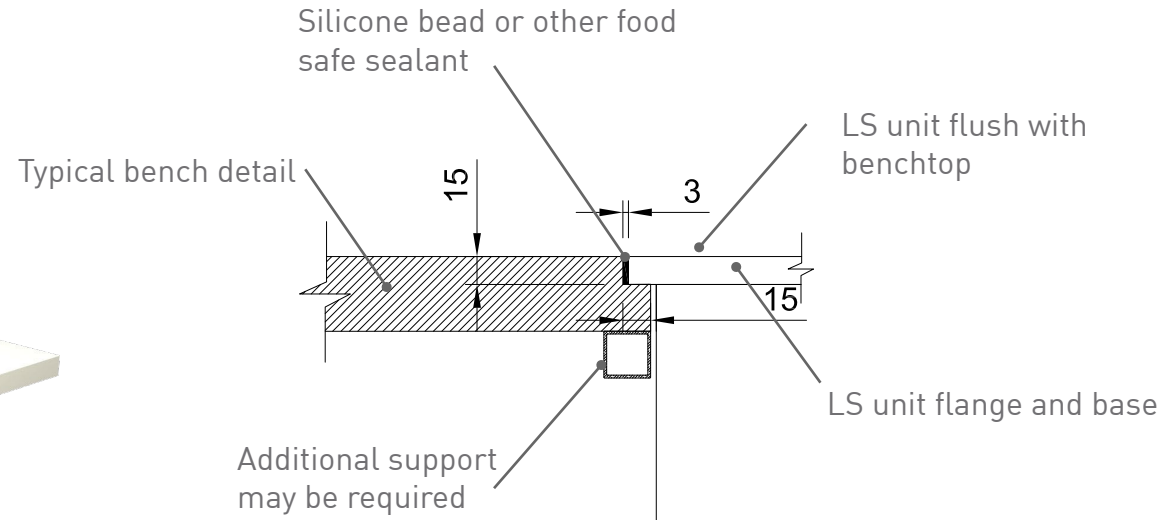


Counter top joinery must be of sufficient structural capacity to take the weight of the LS unit when the flange detail has been made.


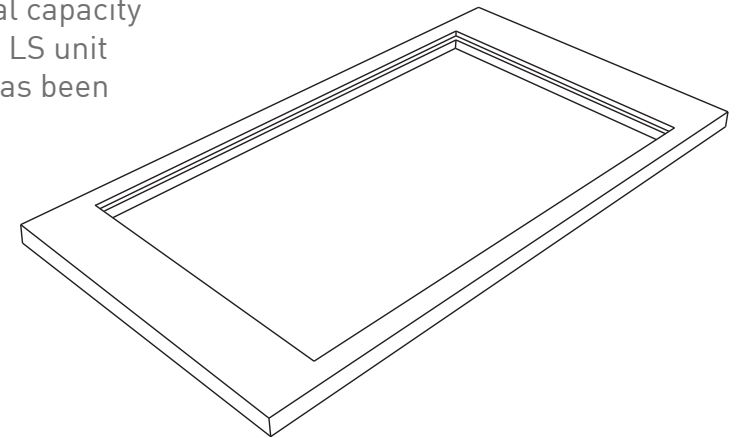


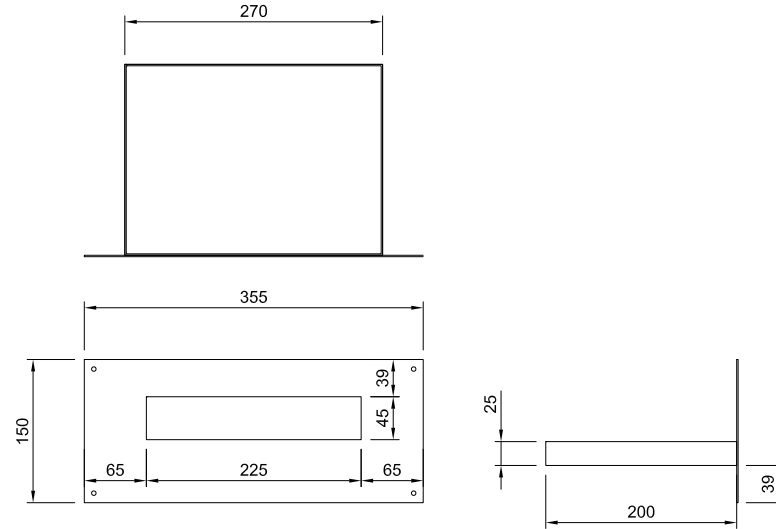

LSCM SIZED CONTROLLER BRACKET

Meltica MDF panel or similar

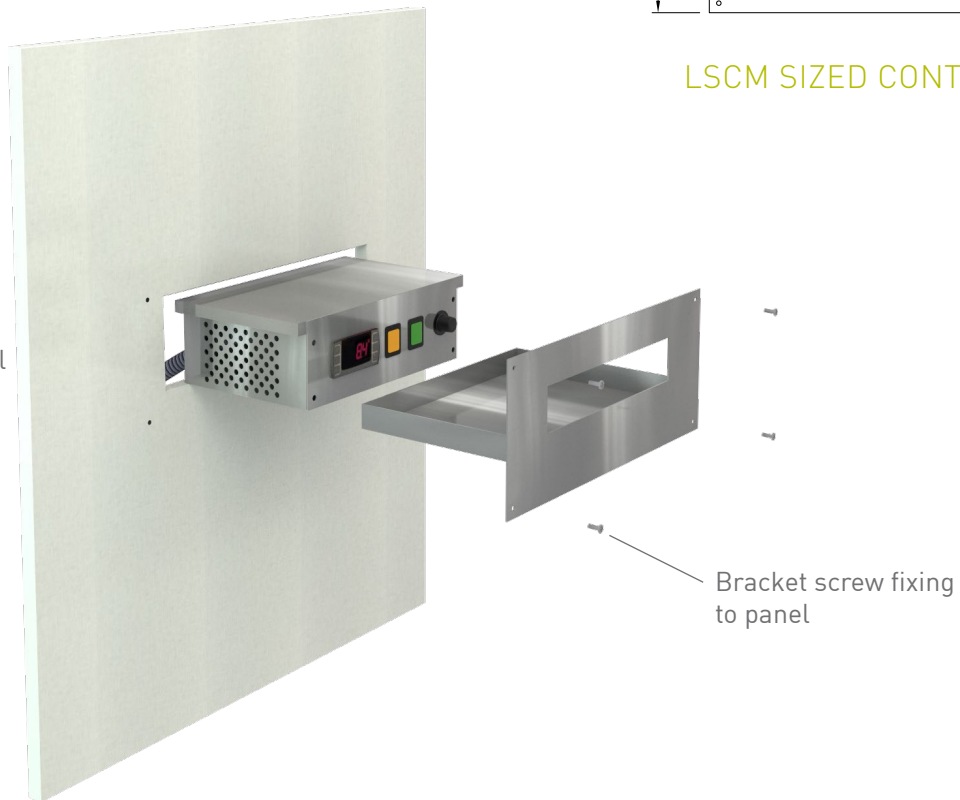

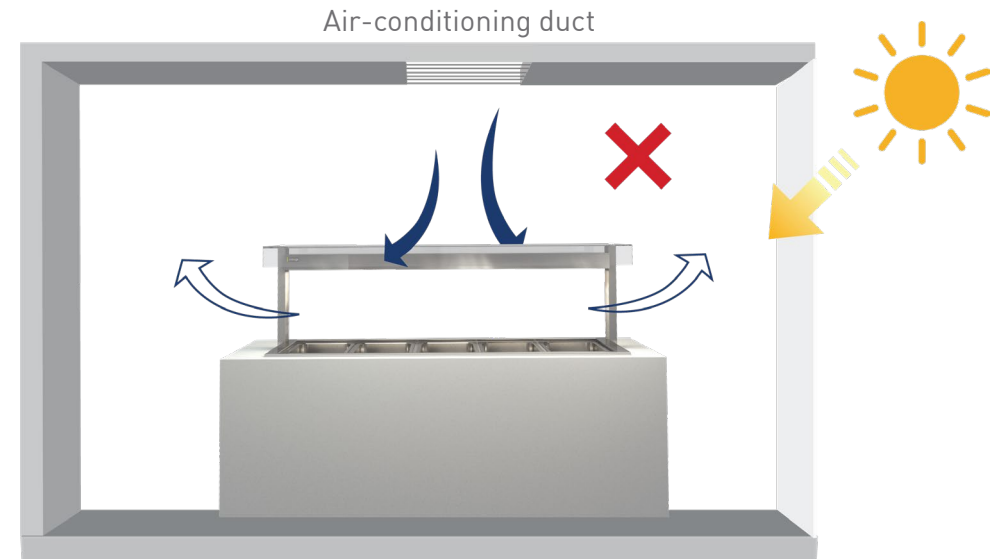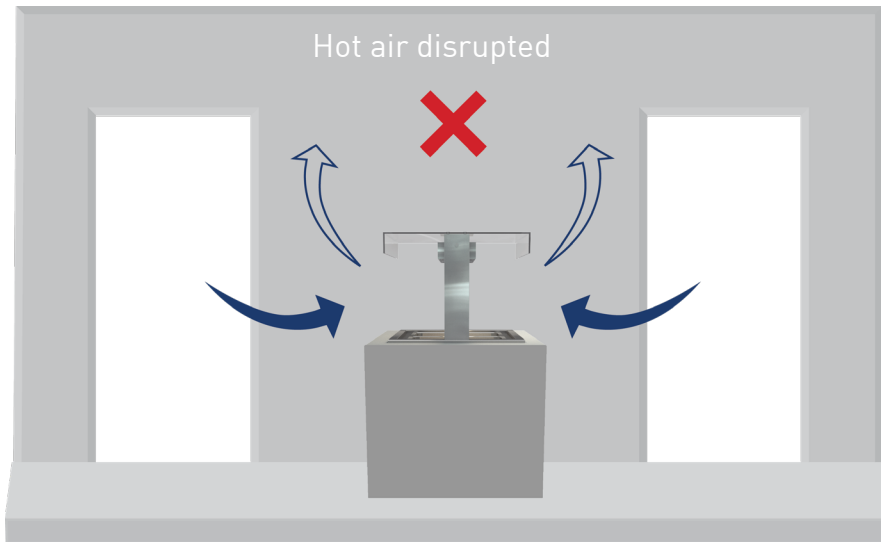

## Locations to avoid

- Drafts from doorways
- Airflow from air-conditioning ducts
- Hot air from motors i.e. refrigerators
- Direct sunlight

## Disrupted air flow

Heat from other equipment and natural conditions, such as direct sunlight straight on units, can cause cooling to fail and overload compressor

Mechanical air flows, such as diffusers and fans can disturb the air curtain on units causing failure